

ERNEST ORLANDO LAWRENCE BERKELEY NATIONAL LABORATORY

Performance of Large Fan Filter Units for Cleanroom Applications

TengFang Xu

Environmental Energy Technologies Division

Chao Ho Lan

Ming-Shan Jeng

Industrial Technology Research Institute, Taiwan

2006

The project was funded by the Industrial Section of the Public Interest Energy Research (PIER) Program of the California Energy Commission through the U.S. Department of Energy under Contract No. DE-AC02-05CH11231..

Disclaimer This document was prepared as an account of work sponsored by the United States Government and California Energy Commission. While this document is believed to contain correct information, neither the United States Government nor any agency thereof, nor California Energy Commission, nor The Regents of the University of California, nor any of their employees, makes any warranty, express or implied, or assumes any legal responsibility for the accuracy, completeness, or usefulness of any information, apparatus, product, or process disclosed, or represents that its use would not infringe privately owned rights. Reference herein to any specific commercial product, process, or service by its trade name, trademark, manufacturer, or otherwise, does not necessarily constitute or imply its endorsement, recommendation, or favoring by the United States Government or any agency thereof, or The Regents of the University of California. The views and opinions of authors expressed herein do not necessarily state or reflect those of the United States Government or any agency thereof or The Regents of the University of California.

Ernest Orlando Lawrence Berkeley National Laboratory is an equal opportunity employer.

Performance of Large Fan-Filter Units for Cleanroom Applications

Tengfang Xu^a (corresponding author)

Chao-Ho Lan^b

Ming-Shan Jeng^b

^aBuilding Technologies Department, Lawrence Berkeley National Laboratory, One Cyclotron Road, Bldg90R3111, Berkeley, CA 95720, USA

Tel: +001.510.486.7810, Fax: +001.510.486.4089, E-Mail: txu@lbl.gov

^bThermofluids Technology Division, Energy & Resources Lab, Industrial Technology Research Institute, Rm. 404B, Bldg. 64, 195, Sec. 4, Chung Hsing Rd., Chutung, Hsinchu, Taiwan 310

Abstract

Fan filter units (FFU's) are widely used in clean space to re-circulate and remove particles out of the airflows directed to cleanrooms or minienvironments. Energy and aerodynamic performance of fan filter units may largely influence both energy efficiency and effectiveness in contamination control in the cleanroom design, qualifications, and operation. This article presents laboratory-measured performance of seven relatively new and large fan-filter units, with a section size of 122-cm-by-122-cm, or 4-ft-by-4-ft. In addition, this article includes a comparison of the performance of these large fan-filter units with that of smaller, 122-cm-by-61-cm (or 4-ft-by-2-ft) fan-filter units that were previously tested. The comparison was based upon a set of performance metrics such as total pressure efficiency and energy performance index. This article found that there were wide variations in the energy performance of FFUs, and that using a consistent evaluation method can generate comparable FFU performance information. When operating at the maximal setting of speed control dials used to control their respective fan wheel speeds, the larger units in this study tended to be more energy efficient than their smaller counterparts, but the energy efficiency level of the same unit may vary considerably, depending on actual operating conditions such as airflow speeds and pressure rise

across the units. Furthermore, this article provides recommendations for further investigations to improve energy efficiency of fan-filter unit applications.

Keywords

Cleanroom, fan-filter unit (FFU), airflow, energy efficiency, total pressure efficiency (TPE), energy performance index (EPI)

Introduction

Cleanroom HVAC systems represent a large fraction of energy use in cleanrooms. Recent studies have found that the performance of HVAC systems varies significantly from cleanroom to cleanroom because of various, and often, complex factors [1] [2]. Such underlying factors include, but are not limited to, requirements for contamination control, design of air-recirculation systems, layout and system resistance of HVAC systems, effectiveness of particle-removal rates, and the energy efficiency of air-system components. Previous studies [2][3][4] [5] addressed energy-saving opportunities in cleanroom applications, one of which was to optimize energy performance in air-recirculation systems.

An FFU is a self-contained unit normally attached to cleanroom T-bar ceilings and is used to supply and clean airflows, which are fed to and then re-circulated through the cleanroom space. The FFU achieves effective contamination control in the cleanroom by providing certain particle filtration and recirculation-air-change rates for a specified space. An FFU usually consists of a small fan, a controller, and a High-Efficiency-Particulate-Air (HEPA) filter or an Ultra-Low-Penetration-Air (ULPA) filter enclosed in a box, which fits into common cleanroom ceiling grids. In recent years air-recirculation systems adopting fan-filter units (FFUs) are increasingly gaining popularity worldwide. This phenomenon is being driven by the needs for

specific contamination control, ease of installation, and adaptability in cleanroom construction, qualification, and operation. Common ceiling grids typically carry FFUs with unit sizes ranging from 122-cm-by-122-cm (4-ft-by-4-ft) down to 122-cm-by-61-cm (4-ft-by-2-ft) or smaller. The small fans inside the FFUs force air through the HEPA or ULPA filters and for an entire cleanroom. The FFU coverage in a cleanroom ceiling normally ranges from 25% to 100% of the total ceiling area in a cleanroom, which requires a large number of FFUs. As a result, the large number of small fans in FFUs constitutes considerable electric power demand and energy use in providing air recirculation and cleaning.

While FFUs are becoming more popular, their energy and aerodynamic performance could be different even with similar components. To achieve sustainable development in cleanroom facilities, it is useful for designers and owners to have comparable information on FFU energy performance. This makes it feasible to select efficient units and to improve energy efficiency while maintaining or improving the effectiveness in contamination control. Unfortunately typical manufacturers datasheets usually contain numbers that look similar but not readily comparable. This is due to the fact that their approaches to reporting performance data are different from each other, and often misleading. For example, an FFU label containing specification of “120-Watts, 55-dBA, 90-fpm (or 0.45-m/s)” conveys vague information because it does not specify what “90-fpm (or 0.45-m/s)” really refers to, nor is the condition under which the labeled information was obtained. Such ambiguity may lead to various interpretations, such as the airflow speed at the room cross-section, across the net HEPA or ULPA filter media, at the face of the HEPA or ULPA filter, or at an unspecified distance from the HEPA or ULPA filter exit. As a result, suppliers’ data information cannot be meaningfully compared or its usefulness is, at most, immaterial.

Lawrence Berkeley National Laboratory (LBNL) and Industrial Technology Research Institute (ITRI) of Taiwan are investigating laboratory methods to consistently test FFU energy and aerodynamic performance [6][7] [8]. Based upon the investigations, we intended to generate data for performance comparison and to identify areas of improvement in the units' energy performance.

Objectives

The objectives of this paper are to 1) present laboratory testing results on aerodynamic and energy performance of seven FFUs with the size of 122-cm-by-122-cm, or 4-ft-by-4-ft; and 2) compare the performance of seven sample FFUs with that of the smaller FFUs (122-cm-by-61-cm, or 4-ft-by-2-ft) that was recently published [8][9][10]. This paper presents the testing results of large fan filter units and evaluates their energy performance when the speed control dial used for adjusting fan wheel speeds in each FFU was set at its maximum.

Approaches

In this study, the individual 122-cm-by-122-cm FFUs were connected with an inlet chamber setup consistent with a test method to determine a fan's aerodynamic performance [7]. The chamber contained a multiple-nozzle bank for recording airflow rates through the tested unit. The air from the mediate downstream of the FFUs was discharged to the atmosphere. A booster fan and a damper were installed at the chamber inlet to modulate air pressures inside the chamber so that the airflow rates and pressure rise across the FFUs were controlled. Figure 1 shows the basic measurement layout.

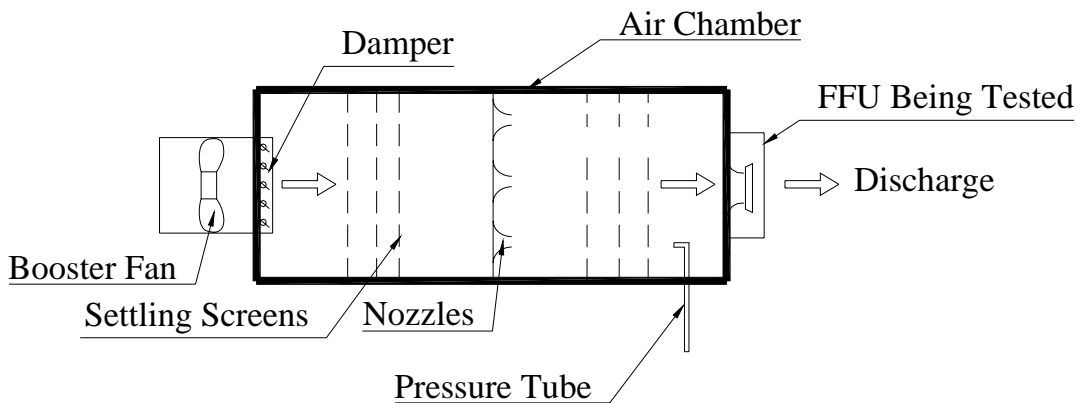


Figure 1 Laboratory measurement layout

The FFUs tested were mounted vertically on the exit end of the air chamber. Exit airflow of the FFU discharged into a room with the air at atmospheric conditions. The HEPA or ULPA filter was considered an integral part of each FFU in this study. The total pressure is the sum of the static pressure and the dynamic pressure at a certain location of the airflow path. The total pressure rise across the FFU is measured within the chamber using the FFU exit location as the base (Figure 1). It represents the "pressure gain" as the air flows through the unit, where the fan impeller exerts energy on the airflow. The FFU pressure rise across the unit therefore represented the unit's capability to overcome the airflow resistance in the re-circulation air system so that the pressure at the HEPA or ULPA filter exit is not less than the ambient pressure. Static pressures at the inlet of each FFU were modulated by adjusting damper positions in order to generate a performance curve covering the range of operable conditions. Each FFU was tested with its speed modulation device set at a highest rotational speed for the fan wheel. The ambient conditions and the airflow conditions were recorded and were used for conversion to the

equivalent standard condition, namely, one standard atm, 20°C, and air density of 1.20 kg/m³, for direct comparisons.

This article focuses on energy and aerodynamics performance of the units and identify areas of further improvement to the testing method and opportunities for energy efficiency. Other performance metrics such as acoustic, vibration, filter efficiency, filter media for controlling airborne molecular contamination, outlet flow uniformity, and in-situ performance, are addressed to various extents, in relevant literatures including standards, certification documents, or recommended practices [11][12][13].

Laboratory Measurements and Metrics

Based on the measured data, we performed data analysis to quantify a group of metrics at various operating conditions developed from the tests. The metrics were recently developed to evaluate energy and aerodynamic performance [10], which allowed direct comparison of the performance of these large FFUs with that of the smaller ones.

One of the examples in examining energy performance of FFUs is to quantify the total pressure efficiency, and electricity power demand (input) per airflow rate under certain operating pressures. These metrics can be used by designers or owners in their life-cycle-cost analysis when needed. They can also be used to formulate energy-efficiency criteria for use in electric utility incentive programs. The following defines the key metrics used in this paper:

- 1) Airflow Speed: Unit airflow rate divided by the net FFU face area under a specific static pressure. Expressed in m/s, or foot per minute (fpm)

- 2) Total Pressure Efficiency (TPE): Ratio of total pressure power to total power demand to an FFU. The total pressure power is obtained by multiplying the airflow rates by the total pressure rise across the unit. Expressed in percentage.
- 3) Energy Performance Index (EPI): Unit's total power demand normalized by the airflow rate through the FFU under certain conditions. Expressed in Watt per m³/min, or Watt per cubic foot per minute (cfm), i.e., W/cfm

A power meter measured actual power input of an FFU with the measurement uncertainty within $\pm 0.5\%$. The uncertainty in the airflow and pressure measurements is within $\pm 2.5\%$. With the magnitudes of airflow speeds in the order of 0.50 m/s (or about 100 fpm) or less, dynamic pressures of airflows through FFUs are usually less than 0.2 Pa. If we consider that pressure drop in the recirculation-air system is around 50 to 100 Pa and that static pressure rise of the units could be higher than 50 Pa, dynamic pressures of airflows with speeds of 0.50 m/s or lower would only account for an insignificant fraction ($< 0.4\%$) of the total pressures. In this article, values of static pressures or total pressures are expressed interchangeably.

Results and Comparisons

This paper evaluates the energy and aerodynamic performance of seven large FFUs (122-cm-by-122-cm, or 4-ft-by-4-ft) that were tested in calibrated laboratory setting [7]. These FFUs were made by various suppliers located in Asia, Europe, and North America. Each of the FFUs tested has backward inclined centrifugal impellers. All of the samples used single-phase or three-phase AC power supply.

1. Pressure Rise across Unit

Figure 2 shows the curves of the pressure rise across the 122-cm-by-122-cm units as it related to the actual airflow speeds at the FFU exit. Each line represents the operable ranges for each of the FFUs when the speed control dial used for adjusting fan wheel speeds in each FFU was set at its maximum.

For a typical cleanroom system resistance of 125 Pa (or about 0.5 inch water), most of the FFUs would operate at airflow speeds typically ranging from 0.25 to 0.50 m/s (or about 50 to 100 fpm). This exhibited a similar trend to those of the smaller, 122-cm-by-61-cm units reported in a previous study [9]. For the majority of the 122-cm-by-122-cm units (five out of seven), the maximal airflow speed in this study was however lower than 0.40 m/s (80 fpm).

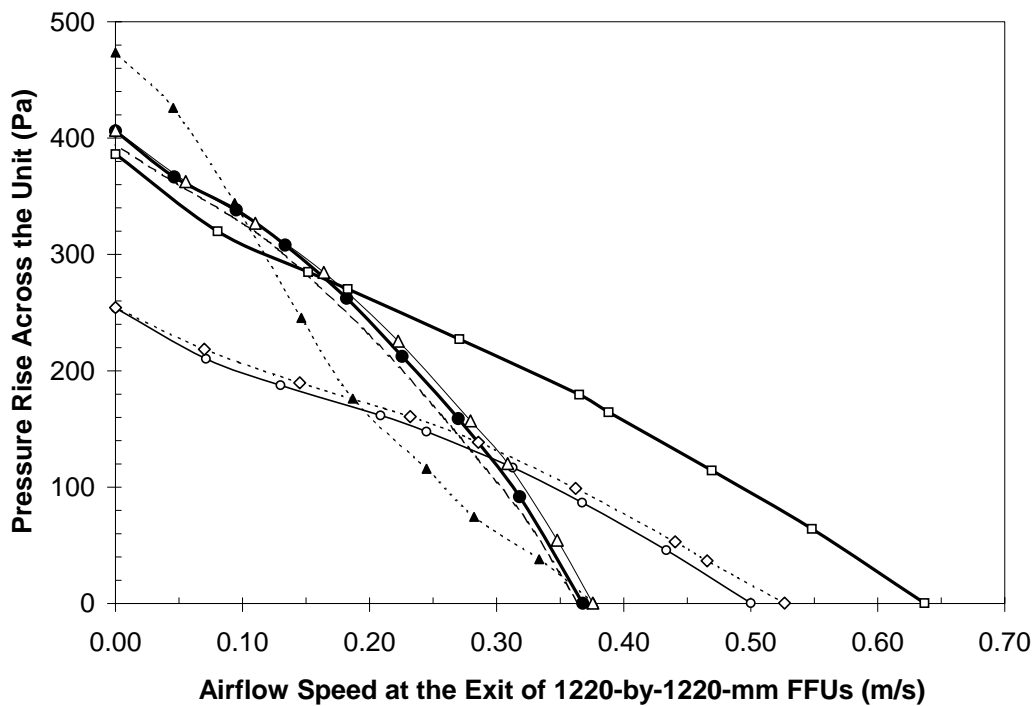


Figure 2 Pressure rise across the unit and airflow speed at FFU exit

The figure indicates that an increase in airflow speeds corresponded consistently with the decrease in pressure rise across the unit - it corresponded to reduced static pressure (and total pressure) as a result of wider opening of the damper coupling with the original fan features.

2. Total Pressure Efficiency

The total pressure efficiency (TPE) is the actual airflow's total pressure power divided by the total electric power input to the FFU unit (Equation 1). Airflow total pressure power is to move air through the FFU at certain airflow conditions. The total FFU pressure efficiency includes electrical efficiency and mechanical efficiency of the whole FFU unit.

$$\text{TPE} = P_t Q / W \quad \text{Equation [1]}$$

where

P_t is the FFU pressure rise (Pa)

Q the airflow rate (m^3/s), and

W is the total electric power input to FFU (Watt).

Figure 3 shows performance curves of individual FFUs in terms of their total pressure efficiency as a function of airflow speeds at the FFU exit. Each line indicates the efficiency range for each of the FFUs tested when the speed control dial used for adjusting fan wheel speeds in each FFU was set at its maximum.

It is clear that there was a peak in the total pressure efficiency as the airflow speed changes progressively from a low rate (e.g., 0.10 m/s) to a higher rate (e.g., 0.30 m/s). Total pressure efficiency of the FFUs varied considerably from unit to unit for the same airflow speed, and exhibited significant variation at different operating airflow speeds, even for the same unit.

The maximal total pressure efficiency of the FFUs, operating with airflow speeds at or below 0.30 m/s (60 fpm), ranged from 20 to 34% with a median of 28%. This was much higher than the median values of the maximal total pressure efficiency of smaller units, i.e., 122-cm-by-61-cm (or 4-ft-by-2-ft) units that were reported in previous studies [8][9]. The majority of the units tested in this study produced airflow speeds within the range of 0.25 and 0.50 m/s, which were typical in cleanroom applications, at a static pressure of about 125 Pa (or about 0.5 inch water).

Additionally, the total pressure efficiency of an individual FFU may deviate away from its peak toward the minimal (e.g., zero) very quickly, corresponding to a relatively narrower range of the airflow speeds.

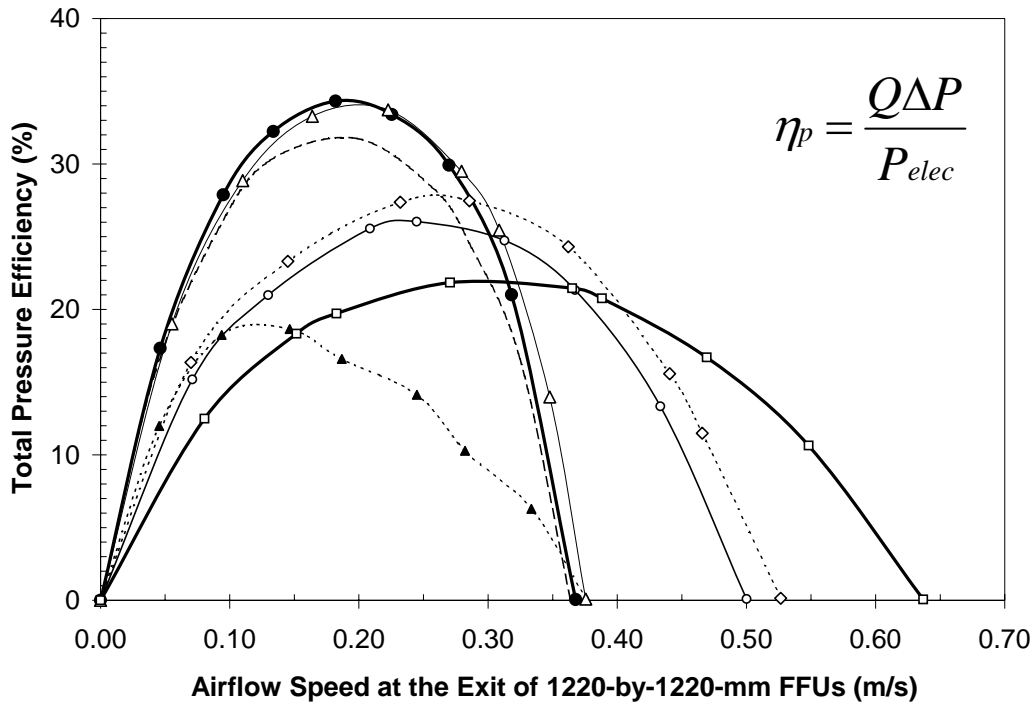


Figure 3 Total pressure efficiency and airflow speed at FFU exit

On the other hand, some of the larger, 122-cm-by-122-cm units with lower total pressure efficiency performed worse than some of the better, smaller 122-cm-by-61-cm units [8][9], in terms of energy and aerodynamic performance. This indicates that FFUs with larger sizes alone did not necessarily yield better energy efficiency, and that there were additional factors affecting the actual energy performance of the units beyond the physical size of the unit, motor and fan.

Figure 4 shows the percentile distribution of the total pressure efficiency of the seven large (122-cm-by-122-cm) units operating at a pressure rise of 125 Pa (0.5 inch water), as compared with that of the ten smaller (122-cm-by-61-cm) units under the same pressure rise condition. The trend of the curves indicated that at a pressure rise of 125 Pa (or about 0.5 inch water), large FFUs, operating within a range of airflow speeds between 0.24 and 0.45 m/s (or about 48 to 90 fpm), exhibited higher total pressure efficiency than did the smaller ones. For example, the total pressure efficiency varied approximately between 15% and 26%, with a median total pressure efficiency value at 25%. This was higher than previous reported values for smaller FFUs [8][9][10], which typically operated within 0.30 to 0.50 m/s - slightly higher airflow speeds.

The energy and aerodynamic performance of the 122-cm-by-122-cm (4-ft-by-4-ft) units can differ significantly at various operating conditions. Some of the units exhibited an even narrower operating range in terms of airflow speed. This indicates that the performance of these larger units exhibited higher sensitivity to the actual airflow speeds; therefore, it is very critical to specify actual operating range for such units in cleanroom and minienvironment applications.

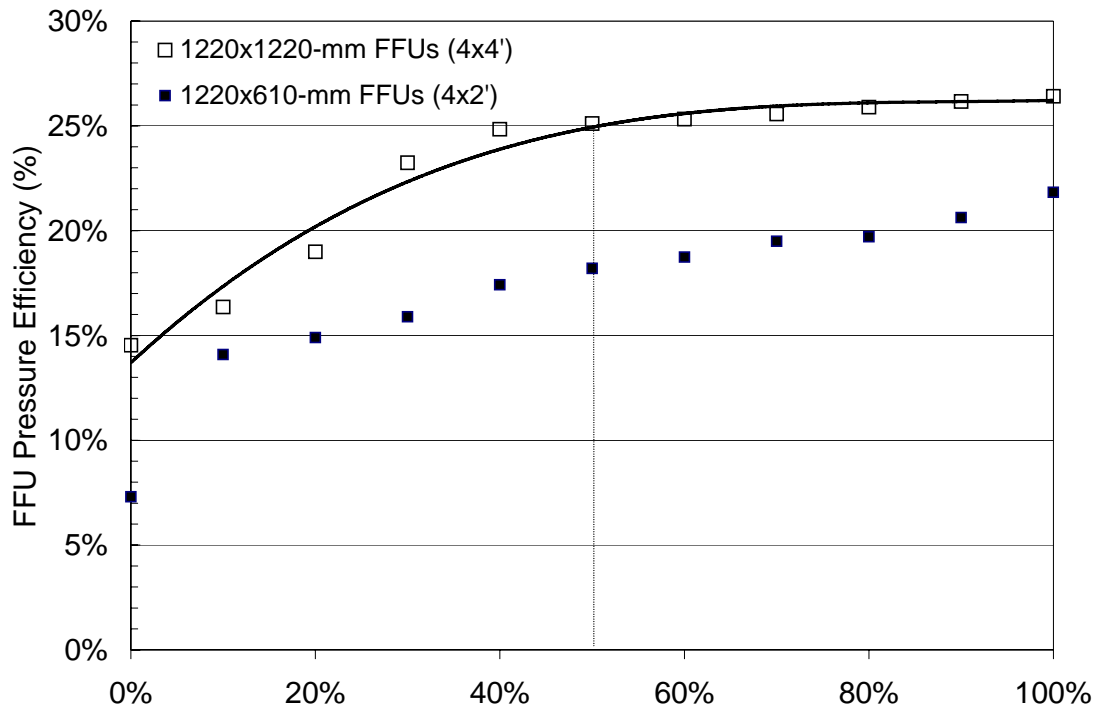


Figure 4 Comparison of FFUs' Pressure Efficiency at 125-Pa Pressure Rise

Compared with the results from the earlier studies, Figure 3 and Figure 4 indicate improvement in the aerodynamic performance of these larger FFUs over their smaller counterparts. The trend of improvement probably is due to a combination of factors such as technology improvement of individual FFU components, fan motor efficiency, lower resistance for a same airflow speed, and design enhancement for the units.

By examining the magnitudes of total pressure efficiency in this study, we can see that the efficiency of one unit could be many times as much as others at a certain condition. Based upon the above analysis, it is clear that there are considerable variations in the FFUs' aerodynamic performance from product to product. It is also clear that there is a potential for some of FFU

suppliers to improve FFU aerodynamic performance under certain operating and design conditions.

3. Energy Performance Index (EPI)

Energy performance index (EPI) represents the electric power demand required for the fan filter unit to re-circulate a certain airflow rate within the cleanroom recirculation system. EPI indicates the level of electricity power intensity given the same airflow rate. A higher value of EPI indicates higher power intensity, and lower efficiency in delivering the same amount of airflow within certain time.

Figure 5 shows the trend of EPI values as they corresponded to various airflow speeds. Each line indicates the EPI range for each of the FFUs tested, when the speed control dial used for adjusting fan wheel speeds in each FFU was set at its maximum. Contrast to the observation from Figure 3 that there was a peak in the total pressure efficiency as the airflow speed changed progressively from a lower level (e.g., 0.10 m/s) to a higher level (e.g., 0.30 m/s), the EPI values decreased consistently with the increase in airflow speeds for each of the units, as shown in Figure 5. This trend indicates that the fan inside the FFU, with a wider damper opening to allow higher airflow rates, would not have to work as hard as it would have to, compared to other cases in which the system-resistance increases (e.g., a narrower damper opening). In this regard, the FFU tends to be more efficient in delivering airflow per power demand at a higher airflow speed.

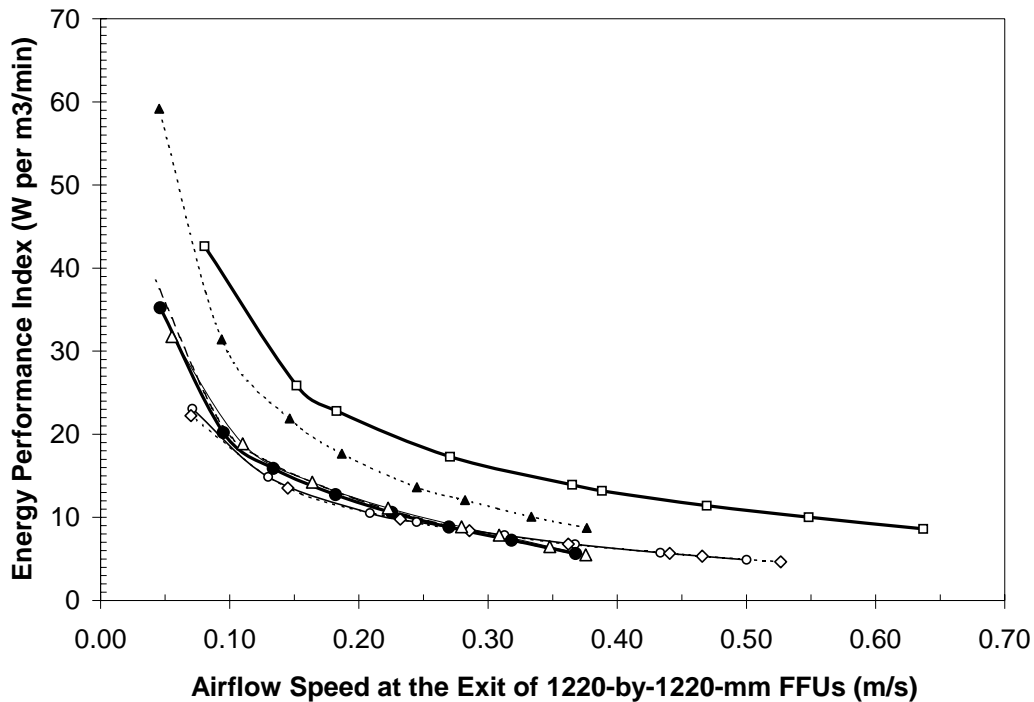


Figure 5 FFUs' Energy Performance Index at 125-Pa Pressure Rise

Energy performance of an FFU was consistently associated with the pressure rise across the unit as well as the airflow speed through the FFU. To quantitatively verify this, we selected the pressure rise at a certain level - 125 Pa to calculate the EPI and the airflow speed, and compare EPI values.

Additionally, Figure 6 shows the EPI values of the seven large FFUs at a pressure rise of 125 Pa (or about 0.5 inch water). The median value of performance index under this condition is identified as 8.3 W per m³/min (or 0.23 W/cfm). This was lower than the median EPI value reported for the ten smaller units under the same pressure-rise condition, which was 11.3 W per m³/min (or 0.32 W/cfm) reported in a previous study [9].

Overall, the differences among the unit's EPI values can be many times as much under a same operating condition. This indicates that there is potential for many of the FFU suppliers to improve FFU energy performance. It also indicates that there is an opportunity for users to select more efficient units and specify optimal operating conditions as a means of improving the performance of their cleanroom systems.

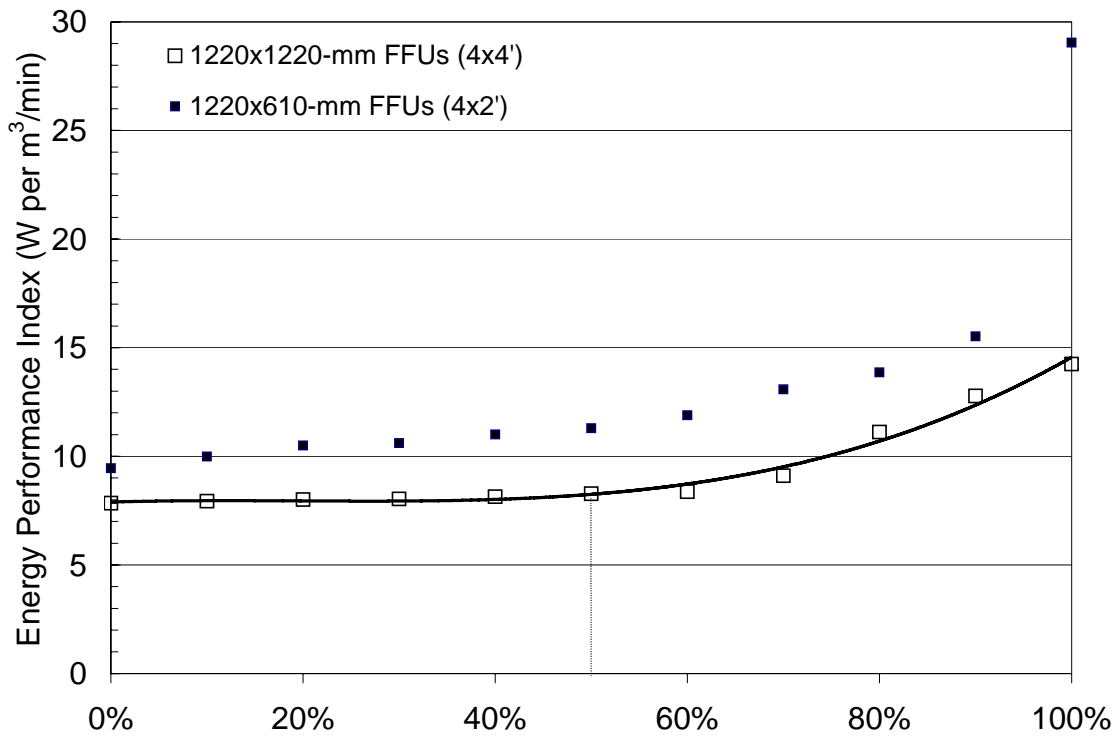


Figure 6 Comparison of FFUs' EPI at 125-Pa Pressure Rise

Conclusions and Recommendations

Laboratory testing of FFU energy performance can provide useful data for suppliers and end users to understand the performance of FFU products. The recommended energy metrics include total pressure efficiency and energy performance index, as they corresponded to operating conditions – airflow speed and pressure rise across the units. This study analyzes the results from the performance tests conducted when the speed control dial used for adjusting fan wheel speeds in each FFU was set at its maximum. Performance information produced in this manner allows direct comparison of the units' energy performance under selected operating conditions.

Appropriate interpretation and use of this information can suggest good practices and strategically create energy-saving opportunities in FFU applications.

From the sample FFUs tested in this study, there were wide variations of energy and aerodynamics performance among the 122-cm-by-122-cm (4-ft-by-4-ft) units at given operating conditions:

- 1) The median value of total pressure efficiency of the 122-cm-by-122-cm (4-ft-by-4-ft) units was higher than their smaller, 122-cm-by-61-cm (4-ft-by-2-ft) counterparts, corresponding to a lower median value of energy performance index of the 122-cm-by-122-cm (4-ft-by-4-ft) units under a same operating condition (e.g., 125-Pa pressure rise across the units). This indicates that higher energy efficiency tended to be associated with the larger units.
- 2) On the other hand, worse performers among the larger, 122-cm-by-122-cm (4-ft-by-4-ft) units showed few or no advantage in energy and aerodynamic performance over some of the better, smaller, 122-cm-by-61-cm (4-ft-by-2-ft) units. This indicates that FFUs with larger sizes alone did not necessarily yield better energy efficiency, and that there were additional factors affecting the actual energy performance of the units beyond the physical size of the unit, motor and fan.
- 3) The energy and aerodynamic performance of the 122-cm-by-122-cm (4-ft-by-4-ft) units can differ significantly at various operating conditions. Some of the units exhibited an even narrower operating range in terms of airflow speed. This indicates that the performance of these large units could be more sensitive to variations in the actual airflow speeds; therefore, it is very critical to specify, select, and control actual operating range for such units in cleanroom and minienvironment applications.

A standard testing method is needed in order to better understand FFU performance and to be able to make meaningful comparisons. Recommendations for future work include investigating the effect of testing configurations on the performance metrics and improving the robustness of the testing method. Further investigations may also include a list of factors contributing to actual units' performance levels, such as motor types, fan wheels, size, design of unit's interior housing, orientations, and opportunities in design, operation, and control to improve FFUs' overall performance.

References

- [1] The Institute of Environmental Sciences and Technology (IEST). 1998. IEST Handbook of Standards and Practices, Recommended Practice in Contamination Control, IEST-RP-CC012.1: Considerations in Cleanroom Design. IEST, 5005 Newport Drive, Rolling Meadows, Illinois, USA
- [2] Xu, T. 2004. Considerations for Efficient Airflow Design in Cleanrooms, Journal of the IEST, Volume 47: 24-28, October 2004, Institute of Environmental Sciences and Technology (IEST), Rolling Meadows, Illinois. Lawrence Berkeley National Laboratory Report, LBNL-55970. Berkeley, Calif., USA
- [3] Xu, T. 2003. Performance Evaluation of Cleanroom Environmental Systems. Journal of the IEST, Vol. 46: 66-73. Institute of Environmental Sciences and Technology (IEST), Rolling Meadows, Illinois. Lawrence Berkeley National Laboratory Report, LBNL-53282. Berkeley, Calif., USA
- [4] Lee, A.H, F. Karman. 2003. Energy Conservation Measures for Industrial Facilities. HPAC Engineering, July 2003: 45-49. 1300 E. 9th St. Cleveland, OH: www.HPAC.com.
- [5] Williamson, M. C. 1998. Energy Efficiency in Semiconductor Manufacturing: A Tool for Cost Savings and Pollution Prevention. Journal of Semiconductor Fabtech, Edition 8 (Section 3: Clean Room).
- [6] Xu, T. 2005. Laboratory Method of Testing Energy Performance of Fan-Filter Units, June 2005, V1.3, Lawrence Berkeley National Laboratory Report, LBNL-54626, Berkeley, Calif., USA
- [7] ASHRAE/ANSI Standard 51 (ANSI/AMCA 210-99). 1999. Laboratory Methods of Testing Fans for Rating, Air Movement and Control Association International, Inc., Arlington Height, Illinois, USA.
- [8] Jeng, M.S., F. Tsau. 2002. Fan-Filter Unit (FFU) Test Procedures. Semiconductor Fabtech, 15th Edition: 77-80.
- [9] Xu, T. and M. Jeng. Laboratory Evaluation of Fan-filter Units' Aerodynamic and Energy Performance, Journal of the IEST, Volume 47: 116-120, October 2004. Lawrence Berkeley National Laboratory Report, LBNL-54250, Berkeley, Calif., USA
- [10] Xu, T. 2004. Introducing a Standard Testing Method for Fan-filter Units, Controlled Environments – Contamination Control for Life Sciences and Microelectronics (formerly A2C2 Magazine), September 2004. Lawrence Berkeley National Laboratory Report, LBNL-55462, Berkeley, Calif., USA
- [11] International Organization for Standardization (ISO). 1999. ISO/DIS 14644-1 Cleanrooms and associated controlled environments. Part 1: Classification of Air Cleanliness. The Institute of Environmental Sciences and Technology (IEST), 5005 Newport Drive, Rolling

Meadows, Illinois, USA

- [12] International Organization for Standardization (ISO). 2002. ISO/DIS 14644-3: Cleanrooms and associated controlled environments. Part 3: Metrology and Test Methods. The Institute of Environmental Sciences and Technology (IEST), 5005 Newport Drive, Rolling Meadows, Illinois, USA
- [13] The Institute of Environmental Sciences and Technology (IEST). 1997. IEST Handbook of Standards and Practices, Recommended Practice in Contamination Control, IEST-RP-CC006.2: Testing Cleanrooms. ISBN: 1-877862-26-6. 5005 Newport Drive, Rolling Meadows, Illinois, USA